


ALL LOCATIONS ARE APPROXIMATE

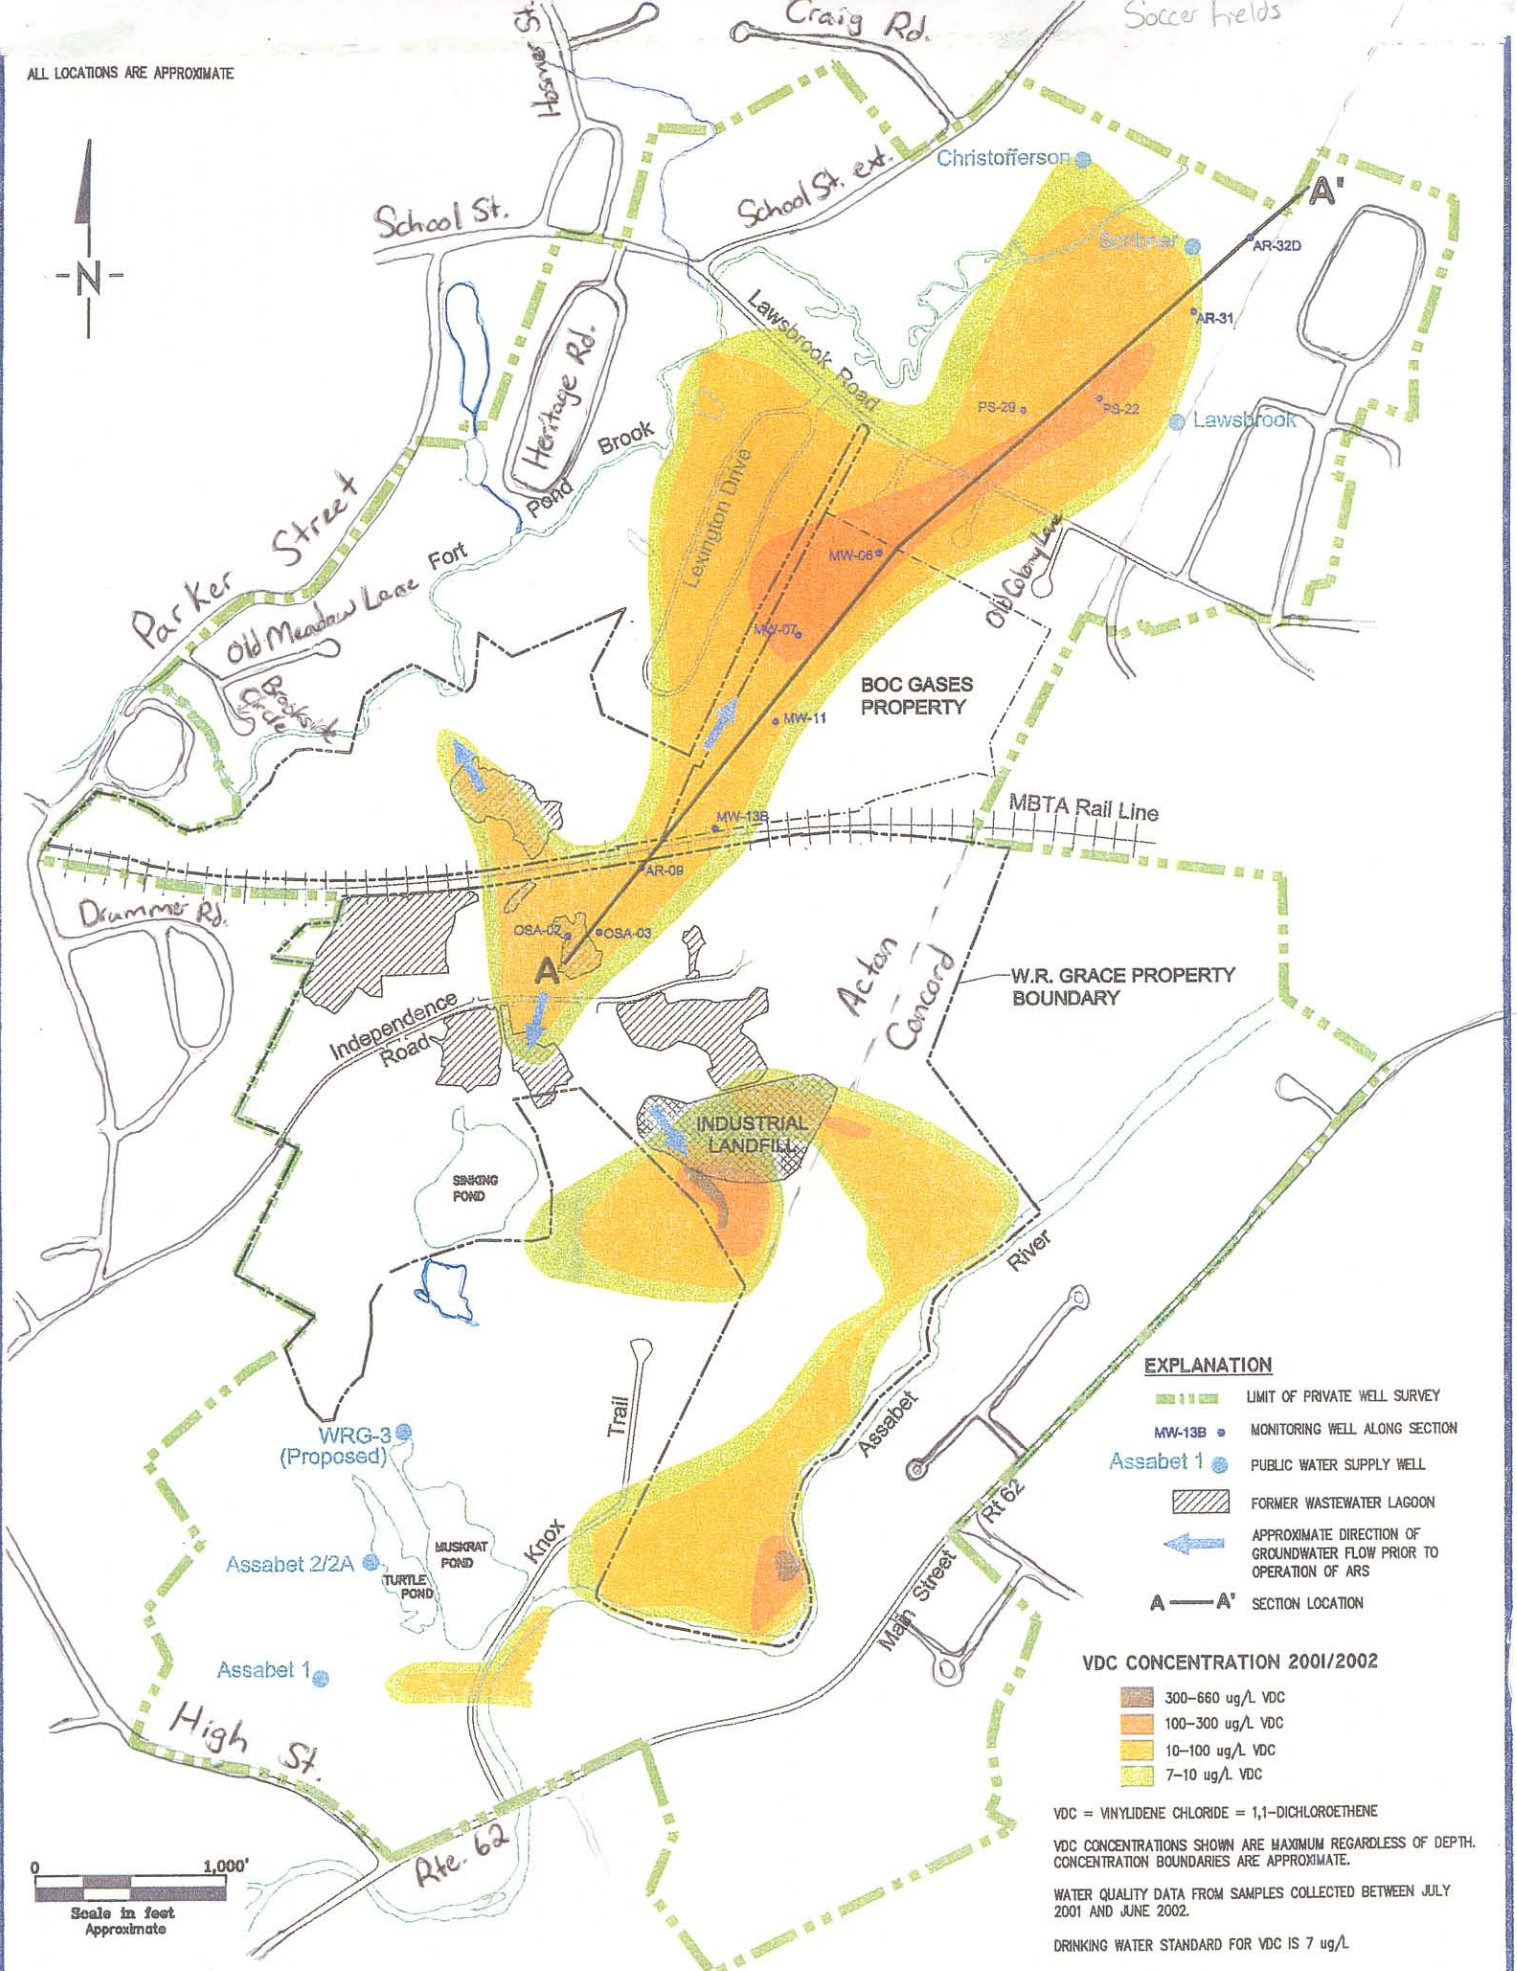

EXPLANATION

- LIMIT OF PRIVATE WELL SURVEY
- MW-13B • MONITORING WELL ALONG SECTION
- Assabet 1 • PUBLIC WATER SUPPLY WELL
- FORMER WASTEWATER LAGOON
- APPROXIMATE DIRECTION OF GROUNDWATER FLOW PRIOR TO OPERATION OF ARS
- A — A' SECTION LOCATION

VDC CONCENTRATION 2001/2002

- 300-660 ug/L VDC
- 100-300 ug/L VDC
- 10-100 ug/L VDC
- 7-10 ug/L VDC

VDC = VINYLIDENE CHLORIDE = 1,1-DICHLOROETHENE

VDC CONCENTRATIONS SHOWN ARE MAXIMUM REGARDLESS OF DEPTH. CONCENTRATION BOUNDARIES ARE APPROXIMATE.

WATER QUALITY DATA FROM SAMPLES COLLECTED BETWEEN JULY 2001 AND JUNE 2002.

DRINKING WATER STANDARD FOR VDC IS 7 ug/L

Figure 1 Distribution of VDC in Groundwater, 2001 - 2002

Map 5 From EPA Community Update, Dec. 2002, Local Street locations have been added